


CONTROLTEC

New



WALL MOUNTABLE CONTROLS FOR HEATING
OR REFRIGERATION
WITH DEFROST OPERATION

Phone: **724-746-1901** Fax: **724-746-2021**
E Mail: **dwight@controlteconline.com**

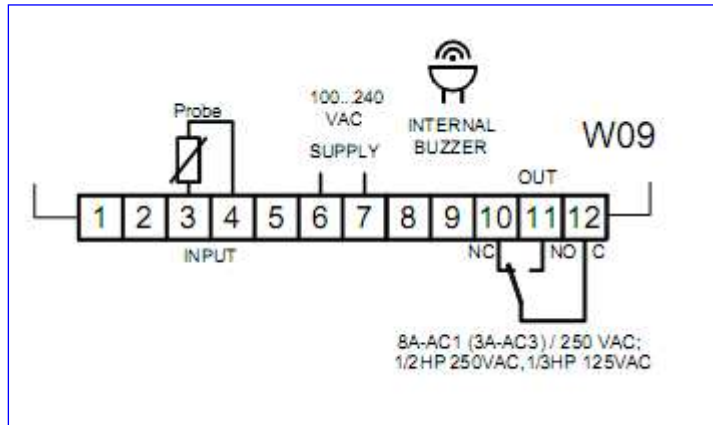

W09

PART NUMBER

POWER SUPPLY

H = 100...240 VAC

OUT

R = Relay SPDT 8A-AC1

BUZZER

B = Buzzer
- = No

CONNECTION


- = Standard by screw terminal

DISPLAY

- = Standard Red with Icons
B = Blue with Icons

W09-HRB-- 100/240 VAC RELAY BUZZER SCREW TERMINAL RED DISPLAY

W09-HR--B 100/240 VAC RELAY NO BUZZER SCREW TERMINAL BLUE DISPLAY

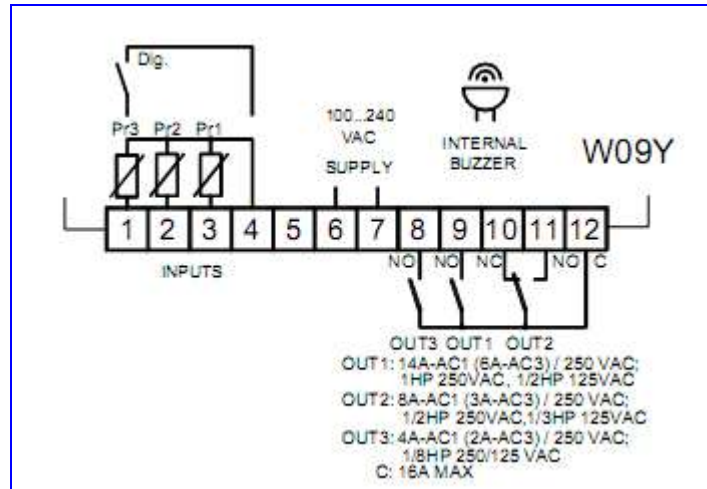

W09Y

PART NUMBER

POWER SUPPLY

H = 100...240 VAC

OUT1

R = Relay SPST-NO 14A-AC1

OUT2

R = Relay SPDT 8A-AC1
- = No

OUT3

R = Relay SPST-NO 4A-AC1
- = No

BUZZER

B = Buzzer
- = No

CONNECTION

- = Standard by screw terminal

DISPLAY

- = Standard Red with Icons
B = Blue with Icons

W09YHRRRB-- 100/240 VAC 3 RELAYS BUZZER SCREW TERMINAL RED DISPLAY

W09YHR----B 100/240 VAC 1 RELAY NO BUZZER SCREW TERMINAL BLUE DISPLAY